


ORIGINAL SIZE A4 DO NOT SCALE, IF IN DOUBT ASK.

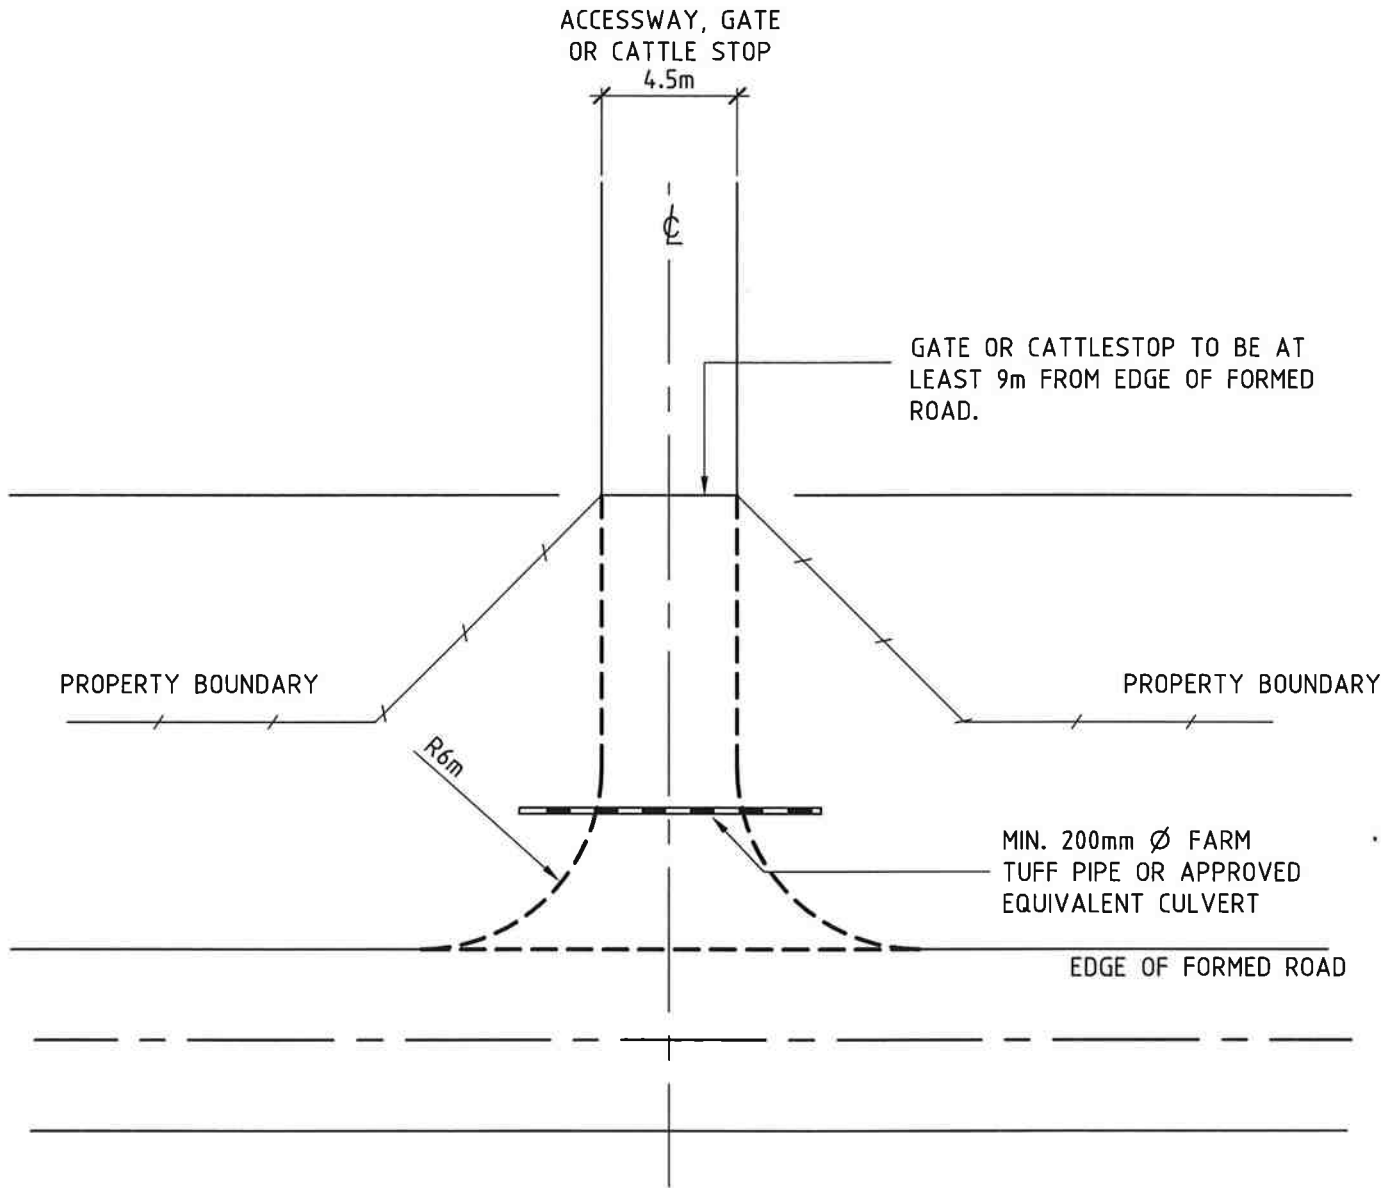

NOTES:

1. CROSSING TO BE MIN. 4.5m WIDE AT ENTRANCEWAY & INCORPORATE MIN. 6m EDGE RADIUS.
2. CONSTRUCTION TO BE OF CRUSHED GRAVEL, AT LEAST 250mm DEEP.
3. ACCESSWAY TO BE SEALED FROM EDGE OF SEAL TO PROPERTY BOUNDARY IF ON A SEALED ROAD.
4. WHERE THE CROSSING INTERCEPTS EXISTING SIDE DRAINAGE, A MIN. 200mm Ø CULVERT IS TO BE INSTALLED.

DATE : February 2008



PRIVATE RURAL ACCESS

SCALE : 1:250

R09-1